

Thermal comfort and older adults

Citation for published version (APA):

Hoof, van, J., & Hensen, J. L. M. (2006). Thermal comfort and older adults. *Gerontechnology*, 4(4), 223-228.
<https://doi.org/10.4017/gt.2006.04.04.006.00>

DOI:

[10.4017/gt.2006.04.04.006.00](https://doi.org/10.4017/gt.2006.04.04.006.00)

Document status and date:

Published: 01/01/2006

Document Version:

Accepted manuscript including changes made at the peer-review stage

Please check the document version of this publication:

- A submitted manuscript is the version of the article upon submission and before peer-review. There can be important differences between the submitted version and the official published version of record. People interested in the research are advised to contact the author for the final version of the publication, or visit the DOI to the publisher's website.
- The final author version and the galley proof are versions of the publication after peer review.
- The final published version features the final layout of the paper including the volume, issue and page numbers.

[Link to publication](#)

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal.

If the publication is distributed under the terms of Article 25fa of the Dutch Copyright Act, indicated by the "Taverne" license above, please follow below link for the End User Agreement:

www.tue.nl/taverne

Take down policy

If you believe that this document breaches copyright please contact us at:

openaccess@tue.nl

providing details and we will investigate your claim.

THERMAL COMFORT AND OLDER ADULTS

Joost van Hoof

Faculty Chair of Demand Driven Care, Hogeschool Utrecht, Bolognalaan 101,
3584 CJ Utrecht, the Netherlands, e-mail: joost.vanhoof@hu.nl

Jan L.M. Hensen

Faculty of Architecture, Building and Planning, Technische Universiteit
Eindhoven, Den Dolech 2, 5612 AZ Eindhoven, the Netherlands

Manuscript prepared as a 'shortie' (permission editor-in-chief, max 2500 words).

ABSTRACT

The majority of the increasing number of older adults wish to age-in-place. Appropriate and comfortable housing is of great importance to facilitate this desire. One of the aspects of concern is thermal comfort. This is normally assessed using the model of Fanger, however one might ask if this model is sufficiently accurate to be used for older adults. This paper provides a short overview of the model, its applicability and implementation, and discusses the need for state-of-the-art air-conditioning systems to offer older adults the best possible indoor climate.

KEYWORDS

Thermal comfort, Older adults, PMV/PPD-model, Heating Ventilation and Air-Conditioning

INTRODUCTION

In 2025, there will be 360 million people aged 60 or over in the Industrialised World¹. The vast majority of older adults that live independently wish to continue their current life style, and therefore ask for extra support and guidance at home, as well as assistive technologies². Some of these technologies can be found in the domain of the building service engineer. One of the aspects of the home environment that is directly related to this profession is thermal comfort, which contributes to well-being and overall health. The current method for assessing thermal comfort in indoor environments is the PMV/PPD-model (Predicted Mean Vote, Predicted Percentage of Dissatisfied) by Fanger³, which is adopted by the (inter)national standards ISO 7730⁴ and ANSI/ASHRAE 55⁵. These standards, which are used in the design of buildings and heating, ventilation and air-conditioning (HVAC) systems, aim to specify conditions that provide comfort to all healthy adults, including older adults⁶, while in practice, a selection of an acceptable percentage of dissatisfied is often made depending on economy and technical feasibility⁷.

Fanger³ created his predictive model through climate chamber research involving approximately 1300 college-age students, followed by much smaller experiments involving 128 elderly subjects to study the influence of age and ageing. The question arises if the PMV/PPD-model is valid for application to the 'healthy' older population, which has different physical characteristics compared to younger groups. Therefore, the PMV/PPD-model and its validity, the impact of age(ing) on the perception of thermal comfort, as well as a correct

implementation in relation to modern heating, ventilation and air-conditioning (HVAC) technologies, will be discussed based on literature study and the latest technological developments.

THE PMV/PPD-MODEL

In order to perceive thermal comfort, the heat gains and losses of the human body must be in balance, the mean skin temperature and sweat rate must be within certain limits, and the body should not experience any local discomfort³. Fanger's Predicted Mean Vote (PMV) model is based on these assumptions, and predicts the 'hypothetical' vote on the standard 7-point ASHRAE scale of thermal sensation for an 'average' person'; i.e. the mean response of a large number of people with equal clothing and activity levels who are exposed to identical and uniform environmental conditions. The model includes six major personal and environmental thermal variables³ (**Figure 1**). To ensure a comfortable indoor environment, the "ideal" PMV is zero (i.e. thermal neutrality) with a tolerance of ± 0.5 ^{4,5}. Fanger established a relation between PMV and the Predicted Percentage of Dissatisfied (PPD)³. PPD is a statistical measure, which applies to a large group of people with identical personal and environmental thermal conditions. In practice however, clothing insulation, metabolic rate, and the environmental thermal conditions may vary considerably between the individuals in a group in a given space.

About here, insert Figure 1

Since the introduction of the PMV/PPD-model in 1970, numerous studies on thermal comfort in real life situations have been conducted. Fountain et al.⁸ state that individual differences between people are frequently greater than one ASHRAE scale value (**Figure 1**) when exposed to the same environment. Moreover, the individual day-to-day perception of a certain environment can also vary in the order of one scale value, which corresponds to 3 K or about the full width of the comfort zone (winter 20-24 °C, summer 23-26 °C). That is the reason why it is unreasonable to expect everyone to be satisfied within a centrally controlled environment, even when thermal conditions meet current standards⁸. Humphreys and Nicol⁹ showed that PMV often does not match the actual sensation of warmth, is only reliable in the comfort range, i.e. between -0.5 and 0.5, and is unable to predict comfort of large groups in realistic conditions. Because PMV is particularly sensitive to air velocity, metabolism and clothing insulation, inaccurate assumptions regarding these parameters can lead to serious misinterpretations⁹. Moreover, the bandwidths of parameters matching correct PMV are narrower than stated in ISO 7730. In addition, its validity range is too narrow for application in tropical areas⁹. De Dear et al.¹⁰ found that the PMV/PPD-model is too restrictive for naturally ventilated (office) buildings, and therefore created an adaptive comfort model^{5,10} that relates indoor to outdoor air temperature. Unfortunately, this model has a

limited applicability as well. Fanger and Toftum¹¹ acknowledge the importance of expectancy accounted for by the adaptive model.

AGEING AND THERMAL COMFORT

In principle, older adults do not perceive thermal comfort differently from younger college-age adults^{2,12}. The effects of gender and age can be accounted for by model parameters such as activity and clothing level¹². On average, older adults have a lower activity level, and thus metabolic rate, than younger persons which is the main reason that they require higher ambient temperatures^{12,13}. The ability to regulate body temperature tends to decrease with age¹². Although 20% of older adults show no vasoconstriction of cutaneous blood vessels, not all of them have diminished control of body temperature¹⁴. Foster et al.¹⁵ found a reduction in the sweating activity of aged men compared to younger age groups. The body temperature threshold for the onset of sweating was increased as well. These differences were even more pronounced in aged women. Tsuzuki and Iwata¹³ found that the evaporative water loss does not significantly increase with metabolic rate in older adults taking light exercise.

In general, older adults have reduced (i) muscle strength, (ii) work capacity, (iii) sweating capacity, (iv) ability to transport heat from body core to skin, (v) hydration levels, and (vi) vascular reactivity, and (vii) lower cardiovascular stability¹².

A number of studies have been conducted on older adults and their preferences of, and responses to, the thermal environment. Some studies found differences in heat balance, or preferences for higher or even lower temperatures between the old and the young, while others have given support to the PMV/PPD-model. Climate chamber research by Tsuzuki et al.¹⁶ showed that the heat balance of older adults was, or appeared to be, less than that of college-age people.

Tsuzuki and Ohfuku¹⁷ found that older adults have reduced warmth sensitivity in cold seasons, and similarly reduced cold sensitivity in hot seasons.

Enomoto-Koshimizu et al.¹⁸ showed through climate chamber research that older adults were thermally neutral at 23 °C operative temperature without heater, and 20 °C with heater, in contrast to 21 °C for young people in both situations. PPD was the lowest at 24 °C operative temperature. Physiologically older adults preferred a warmer environment (+ 2 K) than younger people. It is suggested that, also psychologically, the 20-24 °C comfort zone was not warm enough for older adults.

Collins and Hoinville¹⁹ showed that older adults on average preferred a lower temperature than young people, which was explained in terms of higher clothing insulation. Field research by Cena et al.²⁰ found that elderly in Canada were comfortable at temperatures considered to be too low according to the PMV/PPD-model. This could be explained by an inability to heat the home adequately, a pattern also found in over half of elderly households in Ireland²¹. Tsuzuki and Iwata¹³ found that elderly in general experienced experimental

conditions to be warmer than PMV. Rohles and Johnson²² found that older women felt warmer than younger at the same temperature. No age-dependent difference was found among men. These results contradict expectations that older adults would prefer a higher temperature at same clothing and activity levels, due to lower basal metabolism. Collins and Hoinville¹⁹ explain that older adults may have higher percentages of cutaneous fat decreasing the conductive heat loss. This makes it easier for the body to maintain a certain core temperature at lower ambient temperatures, and will also lead to lower skin temperature, which influences thermal comfort negatively. Moreover elderly may have a decreased perception of (particularly low) temperature¹⁹.

Turnquist and Volmer²³ found an optimum temperature of 25.3 °C for sedentary older adults, which is within the current comfort range. However, the clothing insulation was found to be lower than that of young adults. A study by Collins et al.²⁴ showed that when given control over their environment, older adults preferred the same mean comfort temperature (22-23 °C) but manipulated ambient temperature much less precisely than the young. According to Cena et al.²⁵, studies give support to PMV, even in non-standard groups such as older adults.

In general, elderly seem to perceive thermal comfort differently from the young due to a combination of physical ageing and behavioural differences. Individual differences are too large to draw an unequivocal conclusion on the requirements of older adults regarding their preferred thermal environment. Although there is

evidence that the PMV/PPD model does not completely accurately predict thermal comfort for elderly, currently there exists no better model. It may be concluded that more research is needed on thermal preferences of older adults, for example through field studies in which older adults are given personal control options over their thermal environment.

THE TECHNOLOGICAL HOME ENVIRONMENT

Thermal comfort in the home environment can be achieved through: (i) passive, architectural solutions, e.g. thermal mass, blinds, orientation etc, and (ii) more active technological solutions, such as HVAC-systems and home automation²⁶. Home automation technology includes all in-home devices and infrastructures that use electronic information for measuring, programming, and control of functions to the benefit of the residents. Through the intelligent combination of non-invasive biological and environmental sensors and actuators (**Figure 2**), automatic tuning to individual needs becomes possible². Bottlenecks of current home technologies are inadequate control options for people with decreased muscular, visual and auditory functioning, the limited compatibility of various systems, and financial aspects.

Future dwellings could respond autonomously to changing weather conditions and at the same time optimise energy use. HVAC could be controlled in compliance with personal preferences and rooms could have individual

temperature profiles. Impairment of thermoregulatory functions due to diminished or absent sweating¹⁵ is thought to be one of the factors responsible for increased mortality among older adults during hot summers^{12,27}. This is even more critical for bedridden (institutionalised) older adults, whose clothing insulation is strongly increased by the bed and bedding²⁸, and therefore need lower ambient temperatures (22.5-25.5 °C) compared to mobile people²⁷. Adequate HVAC-systems at home are thus of the utmost importance. Depending on the size, effectiveness and controls of the cooling system, this reduces or eliminates the number of hours with too high indoor air temperature²⁷.

There is no need for prescriptive standards if individual control is provided in order to optimise the indoor environment to personal needs⁸. Although passive building solutions to guarantee thermal comfort are preferred, rooms may be actively controlled for the 'average' occupant¹² based on a PMV/PPD-algorithm using real-time measured input data. Additionally individuals should be given direct control for fine tuning environmental parameters, in time supported by intelligent technology substituting frequent user intervention. Easily operable technology, characterising the future housing of older adults, will increase user autonomy, and provide optimum thermal comfort for everyone, without significantly increasing energy use.

REFERENCES

1. World Health Organization. Active Ageing: A Policy Framework. Geneva, Switzerland: 2002

2. Korhonen I, Pärkkä J, Gils M van. Health monitoring in the home of the future. *IEEE Engineering in Medicine and Biology Magazine* 2003;22(3):66-73
3. Fanger PO. *Thermal Comfort*. Copenhagen, Denmark: Danish Technical Press 1970
4. ISO 7730. Moderate thermal environments. Determination of the PMV and PPD indices and specification of the conditions for thermal comfort. Geneva, Switzerland: International Standard Organization 1994
5. ANSI/ASHRAE Standard 55. Thermal environmental conditions for human occupancy. Atlanta, GA, USA: American Society of Heating, Refrigerating and Air-Conditioning Engineers 2004
6. Cena K, De Dear RJ. Assessment and prediction of thermal comfort of the aged in indoor environments. In Seppälä P, Luopajarvi T, Nygård C-H, Mattila M, editors. *Proceedings 13th Triennial Congress of the International Ergonomics Association*. Tampere, Finland: 1997;5:427-429
7. Fanger PO. The philosophy behind a comfort standard. In Berglund B, Lindvall T, Sundell J, editors. *Proceedings Third International Conference on Indoor Air Quality and Climate*. Stockholm, Sweden: 1984;1:91-98
8. Fountain ME, Brager GS, De Dear RJ. Expectations of indoor climate control. *Energy and Buildings* 1996;24(3):179-182
9. Humphreys MA, Nicol JF. The validity of ISO-PMV for predicting comfort votes in every-day thermal environments. *Energy and Buildings* 2002;34(6):667-684
10. De Dear RJ, Brager GS. Thermal comfort in naturally ventilated buildings, revisions to ASHRAE Standard 55. *Energy and Buildings* 2002;34(6):549-561
11. Fanger PO, Toftum J. Extension of the PMV model to non-air-conditioned buildings in warm climates. *Energy and Buildings* 2002;34(6):533-536
12. Havenith G. Temperature regulation and technology. *Gerontechnology* 2001;1(1):41-49
13. Tsuzuki K, Iwata T. Thermal comfort and thermoregulation for elderly people taking light exercise. In Levin H, editor. *Proceedings of Indoor Air '02*. Monterey, CA, USA: 2002;4:647-652
14. Collins KJ, Exton-Smith AN. Thermal homeostasis in old age. *Journal of the American Geriatrics Society* 1983;31(9):519-524
15. Foster KG, Ellis FP, Dore C, Exton-Smith AN, Weiner JS. Sweat responses in the aged. *Age and Ageing* 1976;5(2):91-101
16. Tsuzuki K, Ohfuku T, Iwata T, Mizuno K. Thermal comfort for the elderly people. In *Proceedings of International Workshop on Gerontechnology: Age-Related Change in Human Factors and Application Technology*. Tsukuba, Japan: National Institute of Bioscience and Human-Technology 2001:107-110

17. Tsuzuki K, Ohfuku T. Thermal sensation and thermoregulation in elderly compared to young people in Japanese winter season. In Levin H, editor. Proceedings of Indoor Air '02. Monterey, CA, USA: 2002;4:659-664
18. Enomoto-Koshimizu H, Kubo H, Isoda N, Yanase T. Effect of the radiant heating on the elderly. In Seppälä P, Luopajarvi T, Nygård C-H, Mattila M, editors. Proceedings 13th Triennial Congress of the International Ergonomics Association. Tampere, Finland: 1997;5:433-435
19. Collins KJ, Hoinville E. Temperature requirements in old age. Building Services Engineering Research & Technology 1980;1(4):165-172
20. Cena K, Spotila JR, Avery HW. Thermal comfort of the elderly is affected by clothing, activity, and psychological adjustment. ASHRAE Transactions 1986;92(2A):329-342
21. Healy JD, Clinch JP. Fuel poverty, thermal comfort and occupancy: results of a national household-survey in Ireland. Applied Energy 2002;73(3-4):329-343
22. Rohles FH, Johnson MA. Thermal comfort in the elderly. ASHRAE Transactions 1972;78(1):131-137
23. Turnquist RO, Volmer RP. Assessing environmental conditions in apartments of the elderly. ASHRAE Transactions 1980;86(1):536-540
24. Collins KJ, Exton-Smith AN, Dore C. Urban hypothermia: preferred temperature and thermal perception in old age. British Medical Journal (Clinical Research Edition) 1981;282(6259):175-177
25. Cena K, Ladd PG, Spotila JR. A practical approach to thermal comfort surveys in homes and offices: discussion of methods and concerns. ASHRAE Transactions 1990;96(1):853-858
26. Stefanov DH, Bien Z, Bang W-C. The smart house for older persons and persons with physical disabilities: structure, technology arrangements, and perspectives. IEEE Transactions on Neural Systems and Rehabilitation Engineering 2004;12(2):228-250
27. Rutten PGS, Hensen JLM. Thermische behaaglijkheid in verpleeghuizen in Nederland in de zomersituatie. Arcen / Eindhoven, the Netherlands: PRelude / HBPS 2002
28. McCullough EA, Zbikowski PJ, Jones BW. Measurement and prediction of the insulation provided by bedding systems. ASHRAE Transactions 1987;93(1):1055-1068

FIGURES AND CAPTIONS

Figure 1.

The Predicted Mean Vote (PMV) is shown with its six input parameters, the relation to the 7-point ASHRAE scale of thermal sensation, and the relation between PMV and PPD is shown.

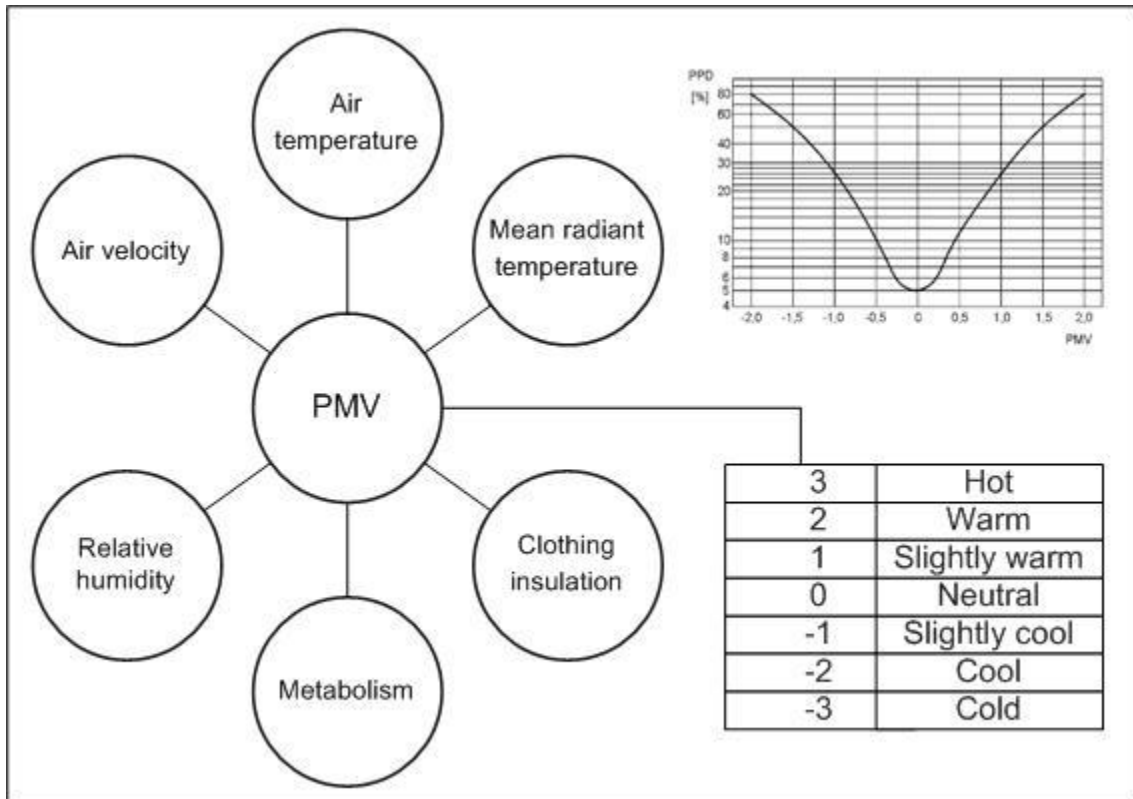


Figure 2.

MyHeart (Royal Philips Electronics) allows for real-time monitoring of a person's body signals, such as activity level, which could be used as input parameter for HVAC-control. MyHeart can be integrated into wearable garment, while a mirror contains a display for user interaction.

